MODEL #PRH9-348

Professional Under Cabinet Hood with Magic Lung® Blower

Professional styling and crisp architectural lines make this hood a versatile fit for both traditional and transitional kitchens. Patented Magic Lung® technology delivers powerful yet exceptionally quiet ventilation through centrifugal filtration, while SensaSource® automatically adjusts blower speed for enhanced grease control and fire safety. Dishwasher-safe components simplify cleanup.

To view available finishes & accessories please visit ventahood.com/products/PRH9-348

SPECIFICATIONS

WIDTH	48"
DEPTH	21"
HEIGHT	9"
CFM [1]	900
EQUIVALENT CFM [2]	1350
SOUND RATING (HIGH SPEED) [3]	6.3 Sones / 56.8 dB
LIGHTING [4]	3 LEDs 2700K Warm White

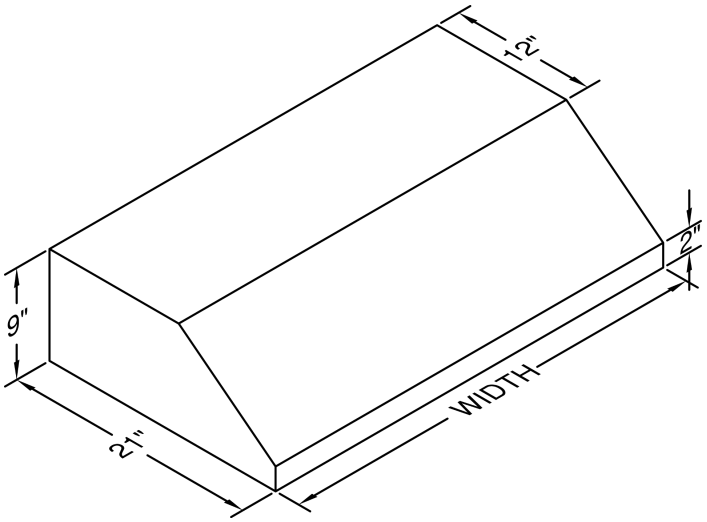

RECOMMENDED MOUNTING HEIGHT

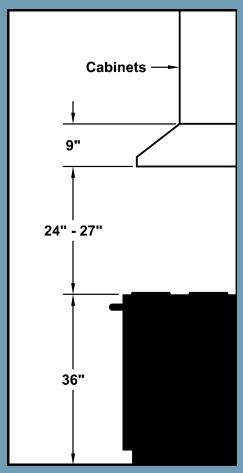

NOTE: Exceeding recommended mounting height may compromise performance.

CONNECTIONS

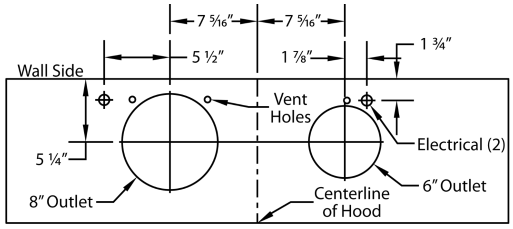

900 CFM B200 Dual & B100 Single Blower (Top View)



VP562 Transition (Optional) For B300 (B200 Dual Blower & B100 Single Blower)



VP562 transition centers outlet over top of hood.

ELECTRICAL/MECHANICAL SPECIFICATIONS FOR BLOWER UNIT

MODEL	VOLTS	AMPS[5]	HZ	RPM	CFM @ 0.0" SP[6]	CFM @ 0.1" SP	CFM @ 0.2" SP	CFM @ 0.3" SP	MIN. ROUND DUCT SIZE
B200 Dual & 1 × B100 Single	**115**	**6.0**	**60**	**1550**	**900**	**804**	**725**	**655**	**10" (79sq.in.)**

[1] CFM (cubic feet per minute) measures airflow. [2] Because Magic Lung® blowers use centrifugal filtration instead of traditional baffle or mesh filters, they move air more efficiently. When comparing to other brands, use Equivalent CFM to understand real-world performance. [3] Sones measure perceived loudness—lower values indicate quieter operation. Decibel values shown are approximate equivalents. [4] WL-1 warming lights are available on selected models. [5] Add 2.5 amps for each warming light. This model is equipped with LED lighting: (2 lights: 30" - 41", 3 lights: 42" - 48"). [6] Airflow (CFM) decreases as duct resistance (static pressure) increases. Values at 0.1"–0.3" SP reflect typical installed conditions.

SPECIFICATIONS SUBJECT TO CHANGE WITHOUT NOTICE 062626